WELL COMPLETION REPORT
3/71

PA29 BREWSTER

PUTNAM COUNTY DEPARTMENT OF HEALTH
Division of Environmental Health Services
COUNTY OFFICE BUILDING - CARMEL, NEW YORK

This report is to be completed by well driller and submitted to County Health Department together with laboratory report of analysis of water sample indicating water is of satisfactory bacterial quality before certificate of construction compliance is issued.

REPORT MUST BE SUBMITTED WITHIN 30 DAYS OF WELL COMPLETION

P1111

41 28 19 73 34 50

OWNER	NAME: Fred Tarquinio	ADDRESS: 62 Marvin Ave. Brewster, N.Y.
LOCATION OF WELL	(Dist. & Street): Rt. 22	(Town): Patterson, N.Y. (Lot Number): 1
PROPOSED USE OF WELL	[X] DOMESTIC; [ ] BUSINESS ESTABLISHMENT; [ ] FARM; [ ] TEST WELL; [ ] PUBLIC SUPPLY; [ ] INDUSTRIAL; [ ] AIR CONDITIONING; [ ] OTHER (Specify)	560 S
DRILLING EQUIPMENT	[X] ROTARY; [ ] COMPRESSED AIR PERCUSSION; [ ] CABLE PERCUSSION; [ ] OTHER (Specify)	
CASING DETAILS	LENGTH (feet): 20 ft.; DIAMETER (inches): 6 in.; WEIGHT PER FOOT: 17 lbs.; [X] THREADED [ ] WELDED; DRIVE SHOE [ ] YES [X] NO; WAS CASING GROUTED? [X] YES [ ] NO	
YIELD TEST	[ ] BAILED; [ ] PUMPED; [X] COMPRESSED AIR; HOURS: 4 hrs.; G.P.M.: 10; YIELD (G.P.M.): 10 gallons	
WATER LEVEL	MEASURE FROM LAND SURFACE—STATIC (Specify feet): water level 30 feet; DURING YIELD TEST (feet): 205 feet; Depth of Completed Well in feet below land surface: 205 feet	
SCREEN DETAILS	MAKE; SLOT SIZE; DIAMETER (inches); IF GRAVEL PACKED: Diameter of well including gravel pack (inches):	LENGTH OPEN TO AQUIFER (feet); GRAVEL SIZE (inches); FROM (feet); TO (feet)

DEPTH FROM LAND SURFACE FEET	to FEET	FORMATION DESCRIPTION
0	6	HARD PAN
7	205	GRANITE

If yield was tested at different depths during drilling, list below

FEET	GALLONS PER MINUTE

Sketch exact location of well with distances, to at least two permanent landmarks.

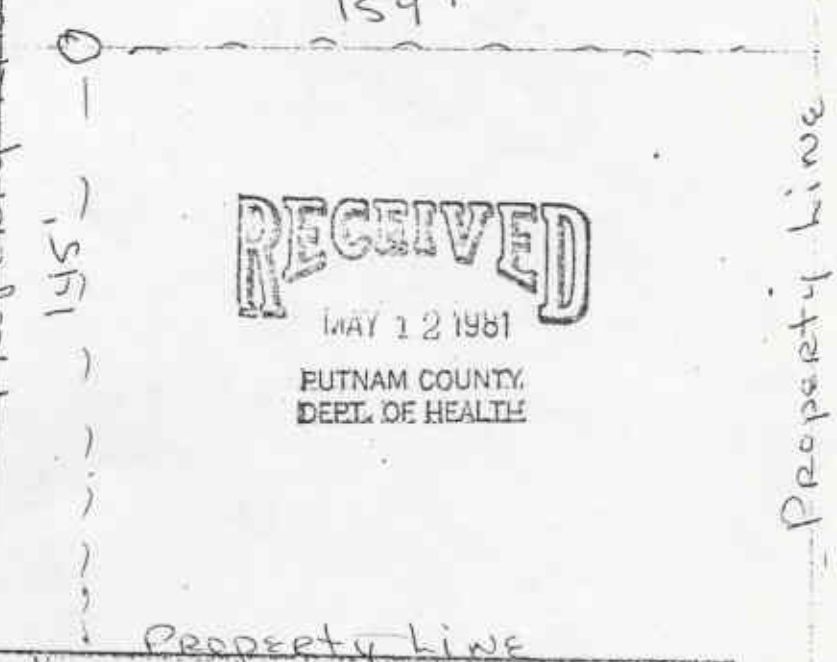

RECEIVED
MAY 12 1981
PUTNAM COUNTY
DEPT. OF HEALTH

DATE WELL COMPLETED	DATE OF REPORT	WELL DRILLER (Signature)
9/11/80	9/22/80	X George Lombardo